

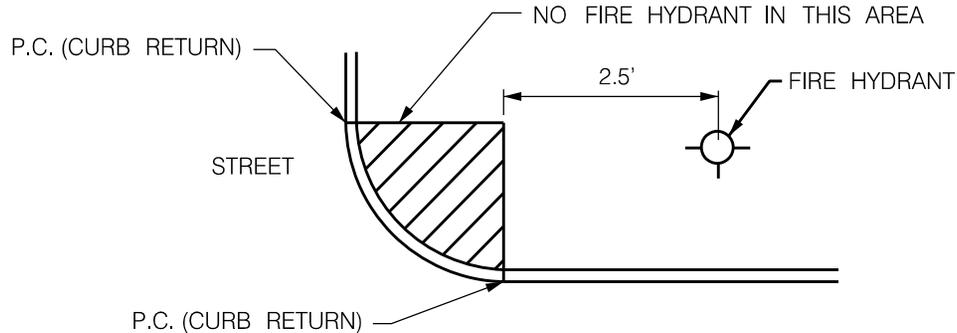


FIRE HYDRANT COLOR CODE

PUBLIC: SILVER
PRIVATE: WHITE (REFLECTIVE)

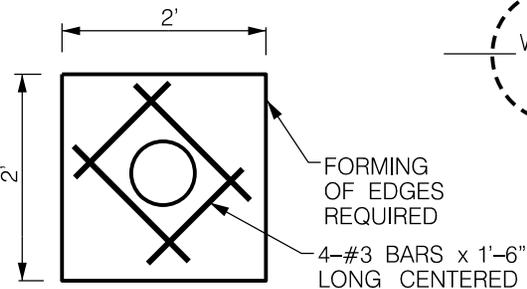

- NOTE:
1. FOR EXTENSIONS OVER 5.0' REFER TO THE "CITY OF LEWISVILLE, GENERAL DEVELOPMENT ORDINANCE MANUAL" FOR MORE INFORMATION.
 2. LIST OF APPROVED FIRE HYDRANTS: MUELLER WATEROUS PACER WB-67.
 3. ALL CONNECTIONS FROM HYDRANT TO MAIN MUST BE FLANGED.
 4. FOR WATER LINE EMBEDMENT. (SEE DWG. 8.1)

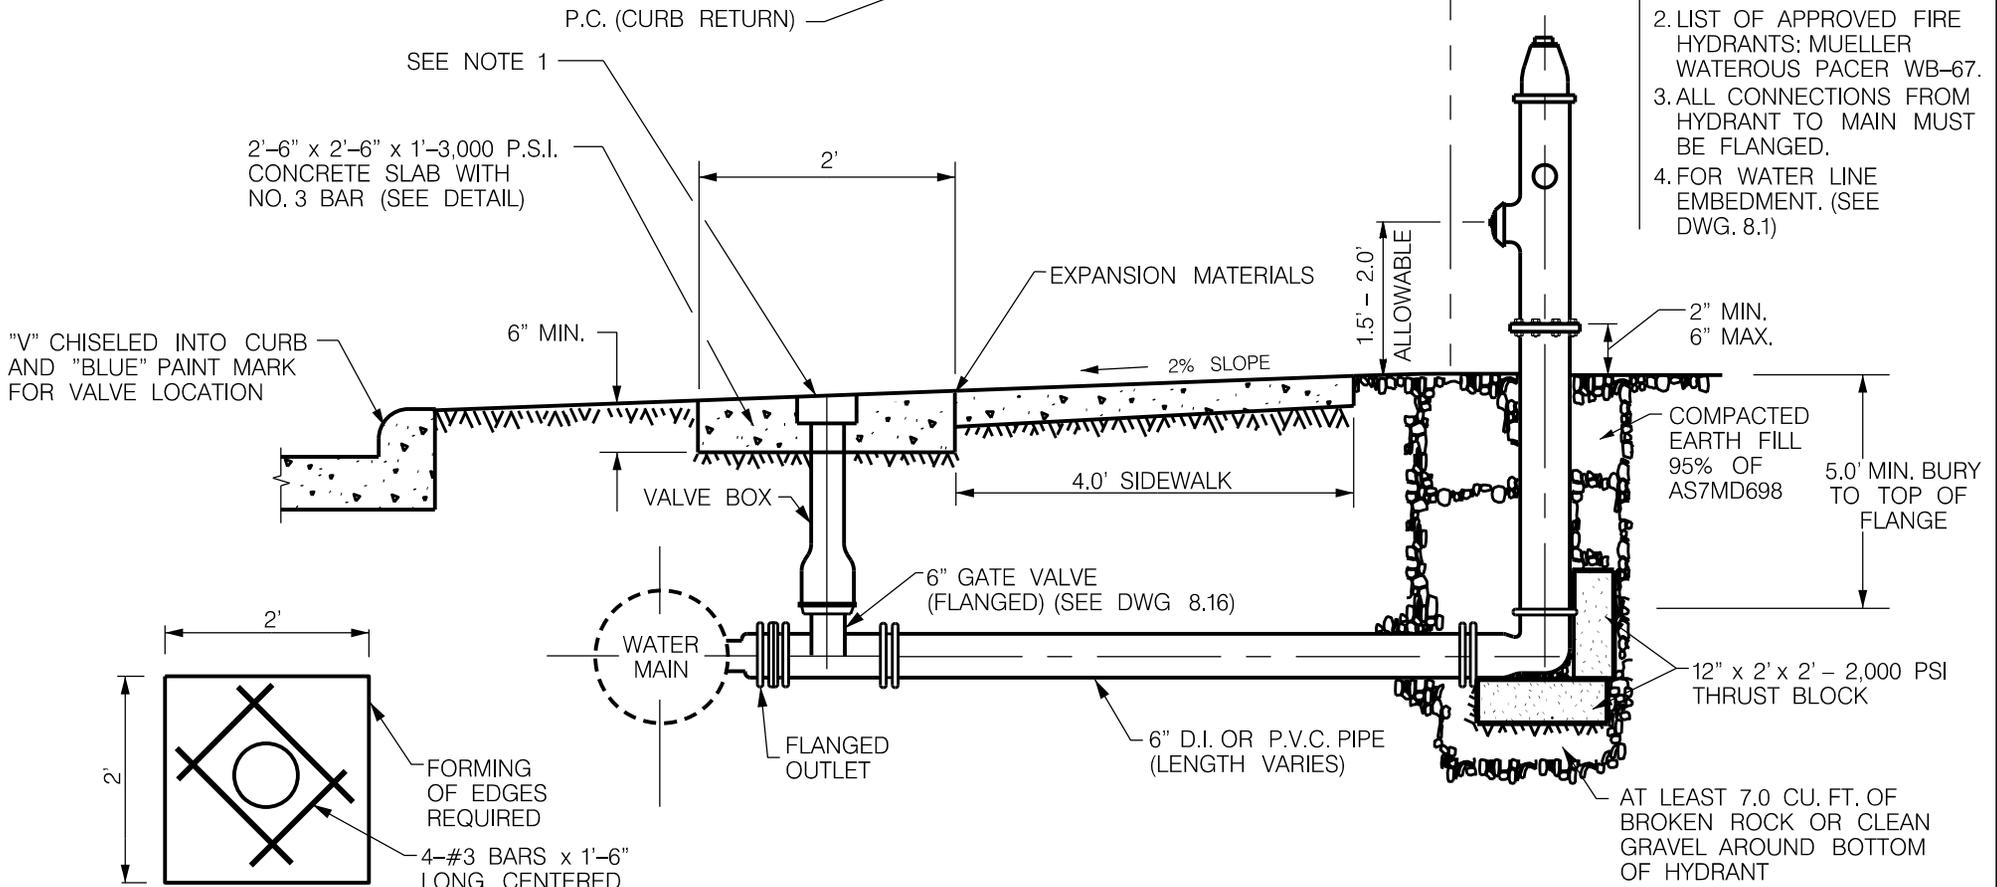

TYPICAL VALVE BOX REINFORCING PLAN

NOTE:
DETAIL SUBJECT TO CHANGE PER DIRECTION OF CITY OF LEWISVILLE ENGINEERING DIVISION

Standard Details
Typical Installation
Fire Hydrant Assembly

Revisions:		
No.	Description	Date

Engineering Department

Office No. 972-219-3490

Dated: 08-17-15

Dated: 09-09-2019

Sheet: