


CONTRASTING LIGHT OR DARK BACKGROUND. THICKNESS OF NUMERALS 1/32" MINIMUM.

CONTRASTING LIGHT OR DARK BACKGROUND OPPOSITE OF THOUSAND GALLON DIAL 1/32" MIN.

3/16" MINIMUM

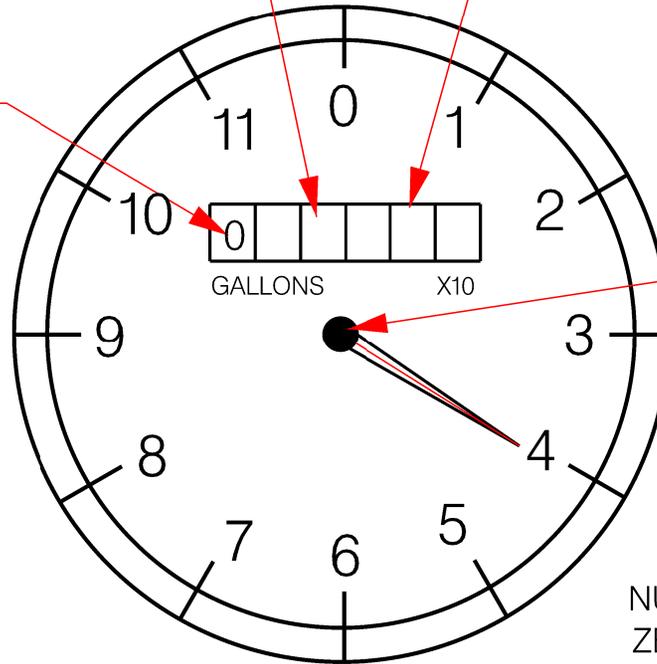

MUST HAVE A LEAK DETECTOR

NUMBER OF DIALS AND FIXED ZEROS MAY VARY ACCORDING TO REGISTRATION REQUIREMENT

METER FACE 2 1/2" MINIMUM DIAMETER

EXHIBIT 1

DUAL BODY COMPOUND METER – 3", 4" & 6"

ALL METERS MUST HAVE A ENCODER TYPE REGISTER THAT MEETS AWWA STANDARD C707-10.

NOTE:
DETAIL SUBJECT TO CHANGE PER DIRECTION OF CITY OF LEWISVILLE ENGINEERING DIVISION



Standard Details

METER FACE DETAIL

Revisions:

No.	Description	Date

Department of
Community
Development

Office No. 972-219-3490
Fax No. 972-219-3487
www.cityoflewisville.com

Dated: 8-13-07

Dated: 11-07-16

Sheet: 8.17