


1/4" x 1" (MIN) STAINLESS STEEL STRAP BOLTED TO SIDE OF WALL

90° BEND (SHORT RADIUS)

FORM INVERT AS REQUIRED (SEE DETAIL THIS SHEET)

6"  
2' MAX.  
0.25' MIN.

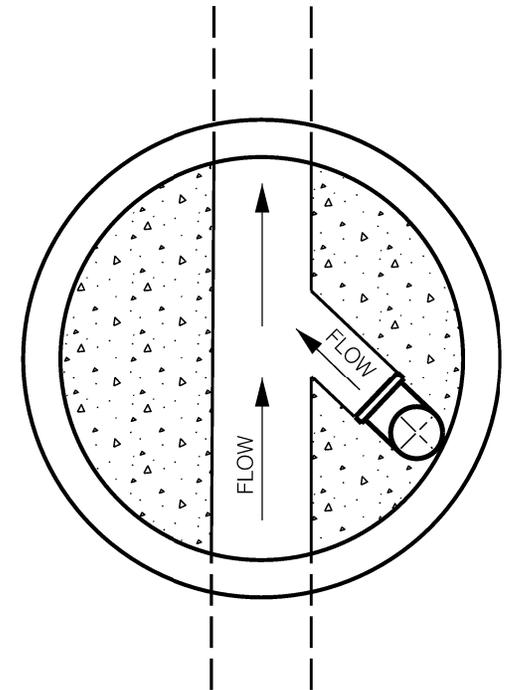

NOTE:  
DETAIL SUBJECT TO CHANGE PER DIRECTION  
OF CITY OF LEWISVILLE ENGINEERING DIVISION.

NOTES:

1. DROP CONNECTION TO OCCUR ALONG INSIDE WALL OF MANHOLE. SHOP DRAWINGS FOR STAINLESS STEEL STRAPS AND BOLTING TO SIDE WALL SHALL BE SUBMITTED TO ENGINEER AND CITY OF LEWISVILLE FOR REVIEW AND APPROVAL, PRIOR TO BEGINNING OF WORK

2. MANHOLES WITH LINES ENTERING OR EXITING 12" OR LARGER REQUIRE 125 MIL RAVIN LINING

Standard Details  
Inside Drop Connection Manhole

Revisions:		
No.	Description	Date

Engineering Department  
Office No. 972-219-3490  
www.cityoflewisville.com

Dated: 9-15-08  
Dated: 09-05-2019  
Sheet: 7.6