


Meter Box will be inset from sidewalk or other structure a minimum of 6" to a maximum 12".

The sides of the meter box will be a minimum of 12" from any walk, drive, or other structure.

The rear of the meter box will be a minimum of 6" from the double check box or any other structure.

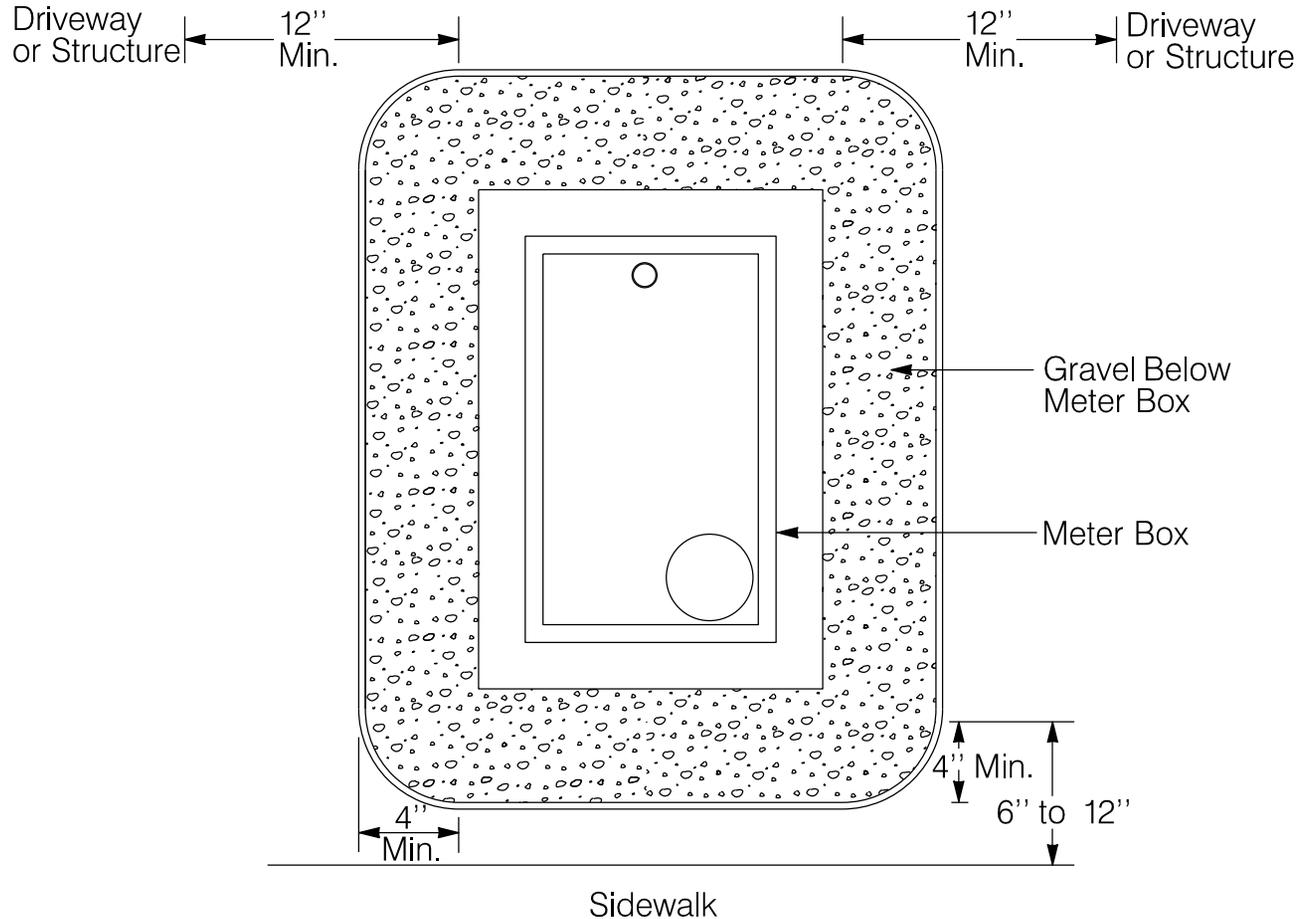

NOTE:  
DETAIL SUBJECT TO CHANGE PER DIRECTION  
OF CITY OF LEWISVILLE ENGINEERING DIVISION



Standard Details  
Residential Water Meter  
(Box Cover)

Revisions:		
No.	Description	Date

Engineering Department

Office No. 972-219-3490

www.cityoflewisville.com

Dated: 8-13-07  
Dated: 10-24-19

Sheet: 8.20