


NOTES:

1. MEGA LUGS (OR APPROVED EQUAL) ARE REQUIRED ON ALL M.J. FITTINGS.

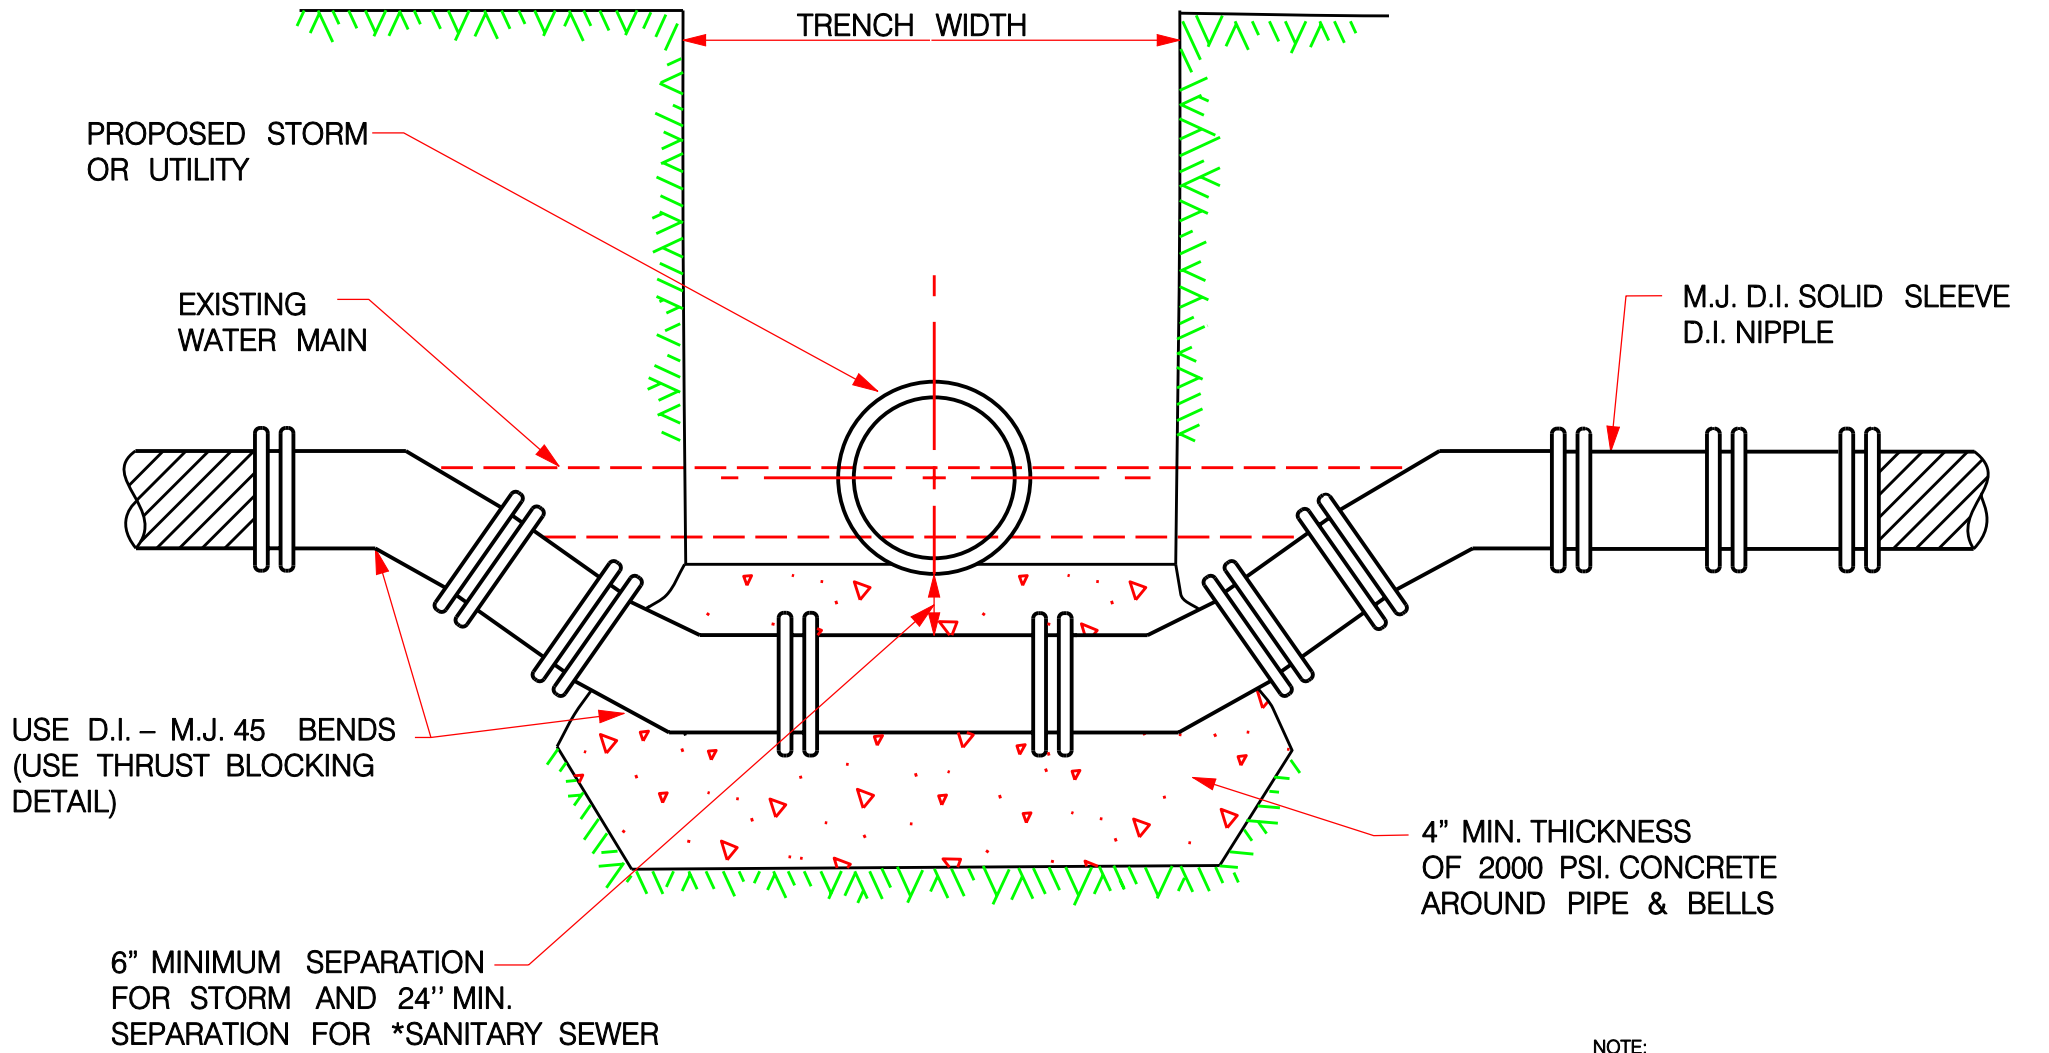

NOTE:
 DETAIL SUBJECT TO CHANGE PER DIRECTION
 OF CITY OF LEWISVILLE ENGINEERING DIVISION

* FOR SANITARY SEWER, PREFERENCE IS TO RAISE WATERLINE OVER THE SEWER IF POSSIBLE



Standard Details
 Water Main Lowering

Revisions:

No.	Description	Date

Department of
 Community
 Development

Office No. 972-219-3490
 Fax No. 972-219-3487
 www.cityoflewisville.com

Dated: 4-27-10
 Sheet: 8.7