


**TYPICAL VALVE BOX
REINFORCING PLAN**

NOTE:
BLOW-OFF VALVE TO BE
LOCATED UNDER BANK OF
CREEK OR DRAIN. EXACT
LOCATION SHALL BE
DETERMINED BY THE ENGINEER.

NOTE:
MEGA LUGS (OR APPROVED
EQUAL) ARE REQUIRED ON
ALL M.J. FITTINGS.

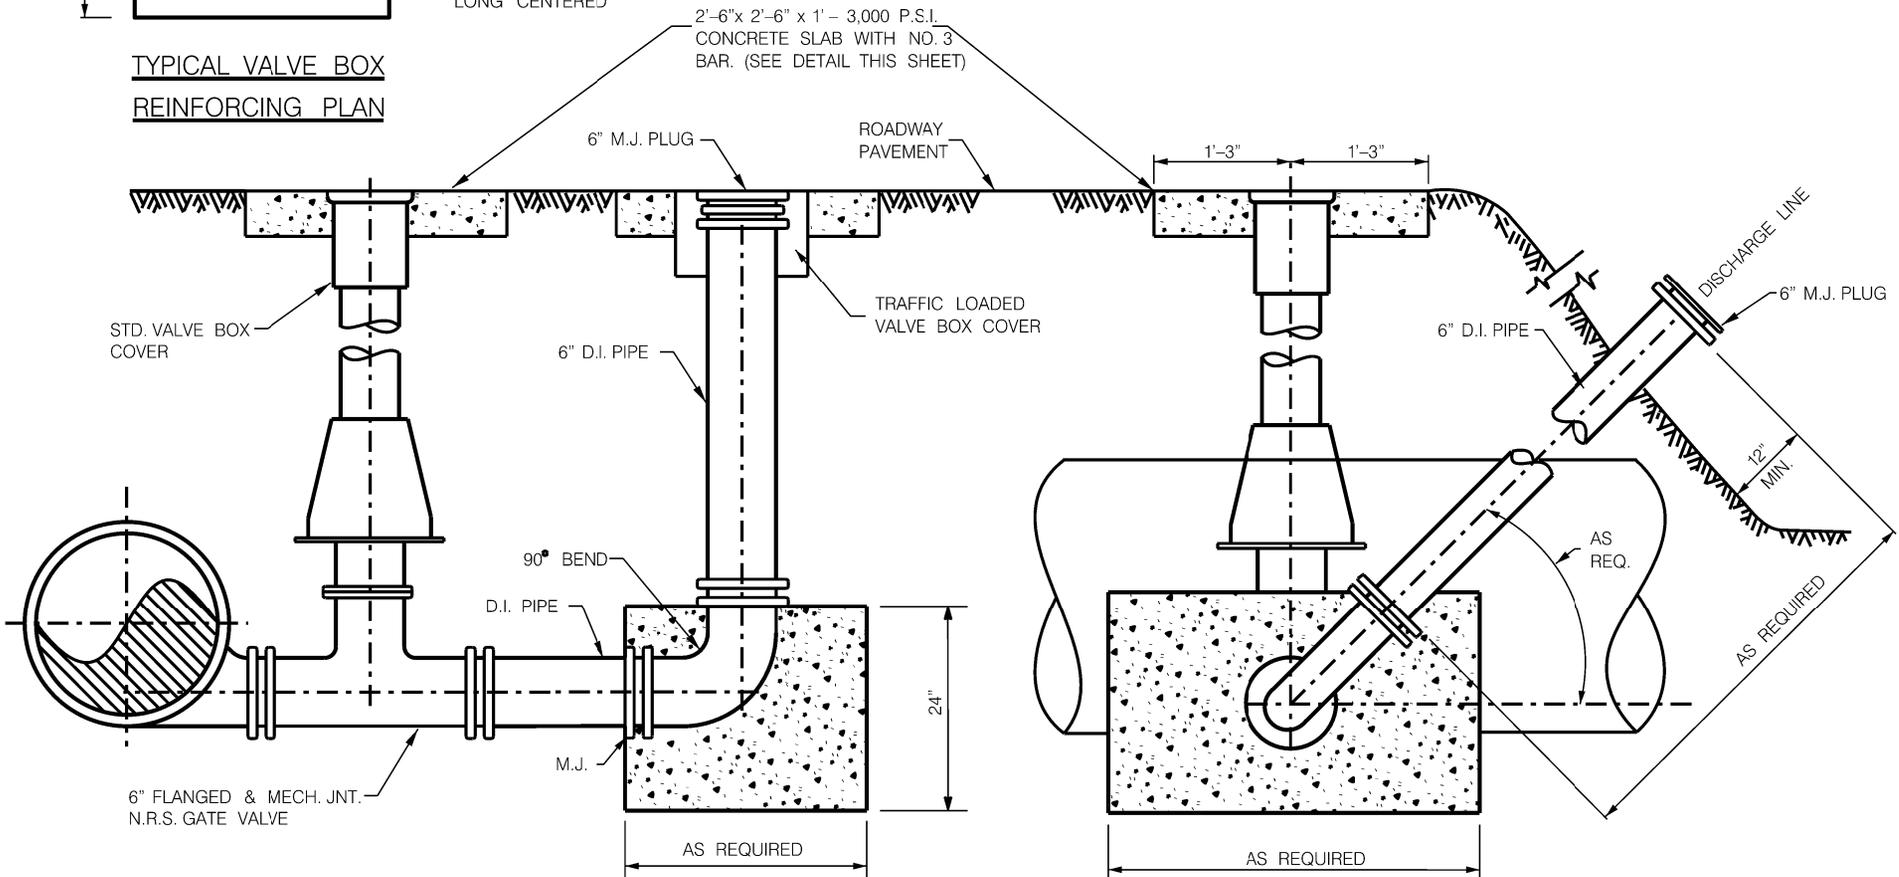

NOTE:
THE DISCHARGE LINE HAS BEEN OFFSET
FOR CLARITY. THE DISCHARGE LINE
SHALL EXTEND VERTICALLY AT 90° ANGLE
TO THE PAVEMENT.

2,000 PSI CONC. THRUST BLOCK
TO BE PLACED ON UNDISTURBED EARTH

NOTE:
DETAIL SUBJECT TO CHANGE PER DIRECTION
OF CITY OF LEWISVILLE ENGINEERING DIVISION



Standard Details
**Modified Blow-Off Valve
Installation**

Revisions:		
No.	Description	Date

Engineering
Department

Office No. 972-219-3490

www.cityoflewisville.com

Dated: 3-13-07

Dated: 09-09-2019

Sheet:

8.4