



NOTES:

1. ALL FITTINGS, CORPORATIONS AND CURB STOPS TO BE COMPRESSION FITTINGS. (FLARED FITTINGS WILL NOT BE ALLOWED)
2. 90 DEGREE CONNECTION IS TYPICAL FOR ALL LONG SERVICES AND SHORT SERVICES IN EXCESS OF 3 FEET.
3. 45 DEGREE CONNECTION IS TYPICAL FOR SHORT SERVICES LESS THAN 3 FEET.
4. BRASS SADDLES WILL BE REQUIRED ON ALL SERVICE CONNECTIONS.
5. SET CURB STOP WITH LOCK AT OR NEAR PROPERTY LINE AT END OF EACH SERVICE CONNECTION LOCATION

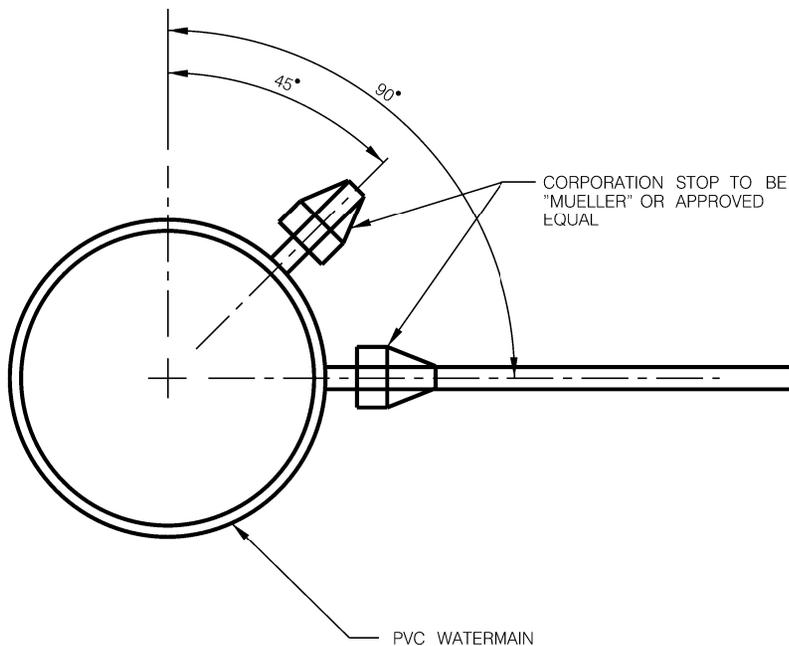

NOTE:
DETAIL SUBJECT TO CHANGE PER DIRECTION
OF CITY OF LEWISVILLE ENGINEERING DIVISION

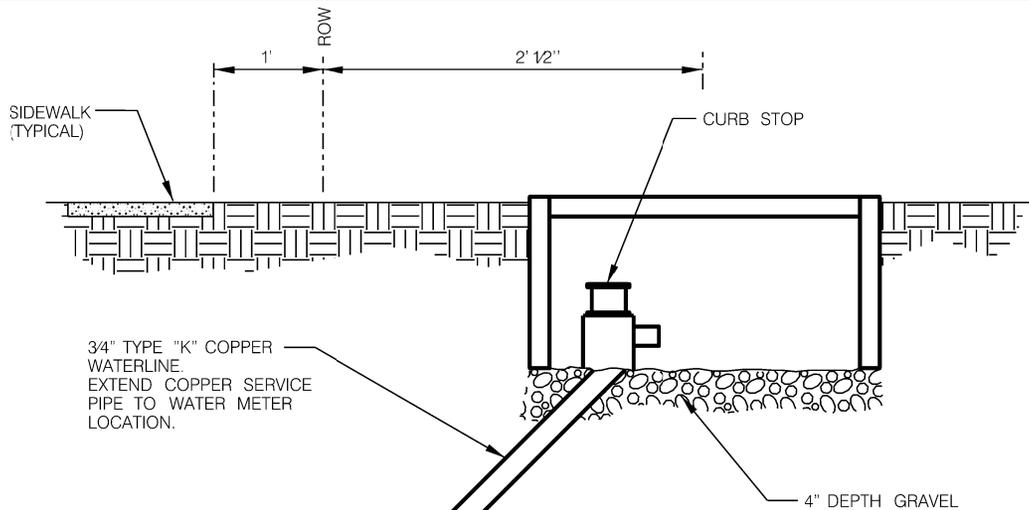

Standard Details

Typical Service Connection

Revisions:

No.	Description	Date

Engineering Department

Office No. 972-219-3490

www.cityoflewisville.com

Dated: 3-13-07

Dated: 09-09-2019

Sheet:

8.2