


NOTE:

STUBOUTS TO BE A MINIMUM OF 2' LONG WITH A CONCRETE CRADLE UNDER THE ENTIRE LENGTH.

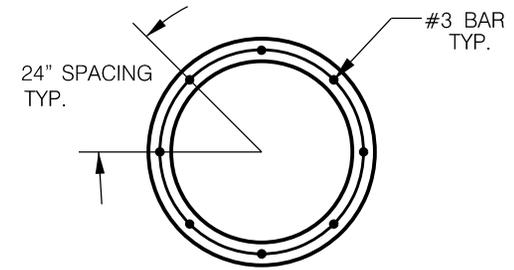

SECTION A - A
(CAGE DETAIL)

* MANHOLE NOTES

MANHOLE NOTES:

1. ALL SANITARY SEWER MANHOLES FOR SEWERS LARGER THAN 12" DIA. SHALL BE SPRAYED WITH THE FOLLOWING CORROSION RESISTANT COATING: RAVEN 405-100% SOLIDS, SOLVENT FREE ULTRA HIGH-BUILD EPOXY SYSTEM FROM RAVEN LINING SYSTEMS WITH A MINIMUM THICKNESS OF 125 MILS.

2. ALL MANHOLES SHALL BE PRECAST. NO CAST-IN-PLACE MANHOLES WILL BE ACCEPTED.

NOTES:

MANHOLES WITH LINES ENTERING OR EXITING 12" OR LARGER REQUIRE 125 MIL RAVIN LINES

NOTE:
DETAIL SUBJECT TO CHANGE PER DIRECTION OF CITY OF LEWISVILLE ENGINEERING DIVISION.



Standard Details
Precast Manhole
Eccentric

Revisions:

No.	Description	Date

Engineering
Department

Office No. 972-219-3490

Sheet: 7.4

www.cityoflewisville.com

Dated: 4-27-10

Dated: 09-05-2019

7.4